


Leaving Water Temperature

WD_Curve

Date Modified: 16/01/2025 Design = 50C @ -3.2C

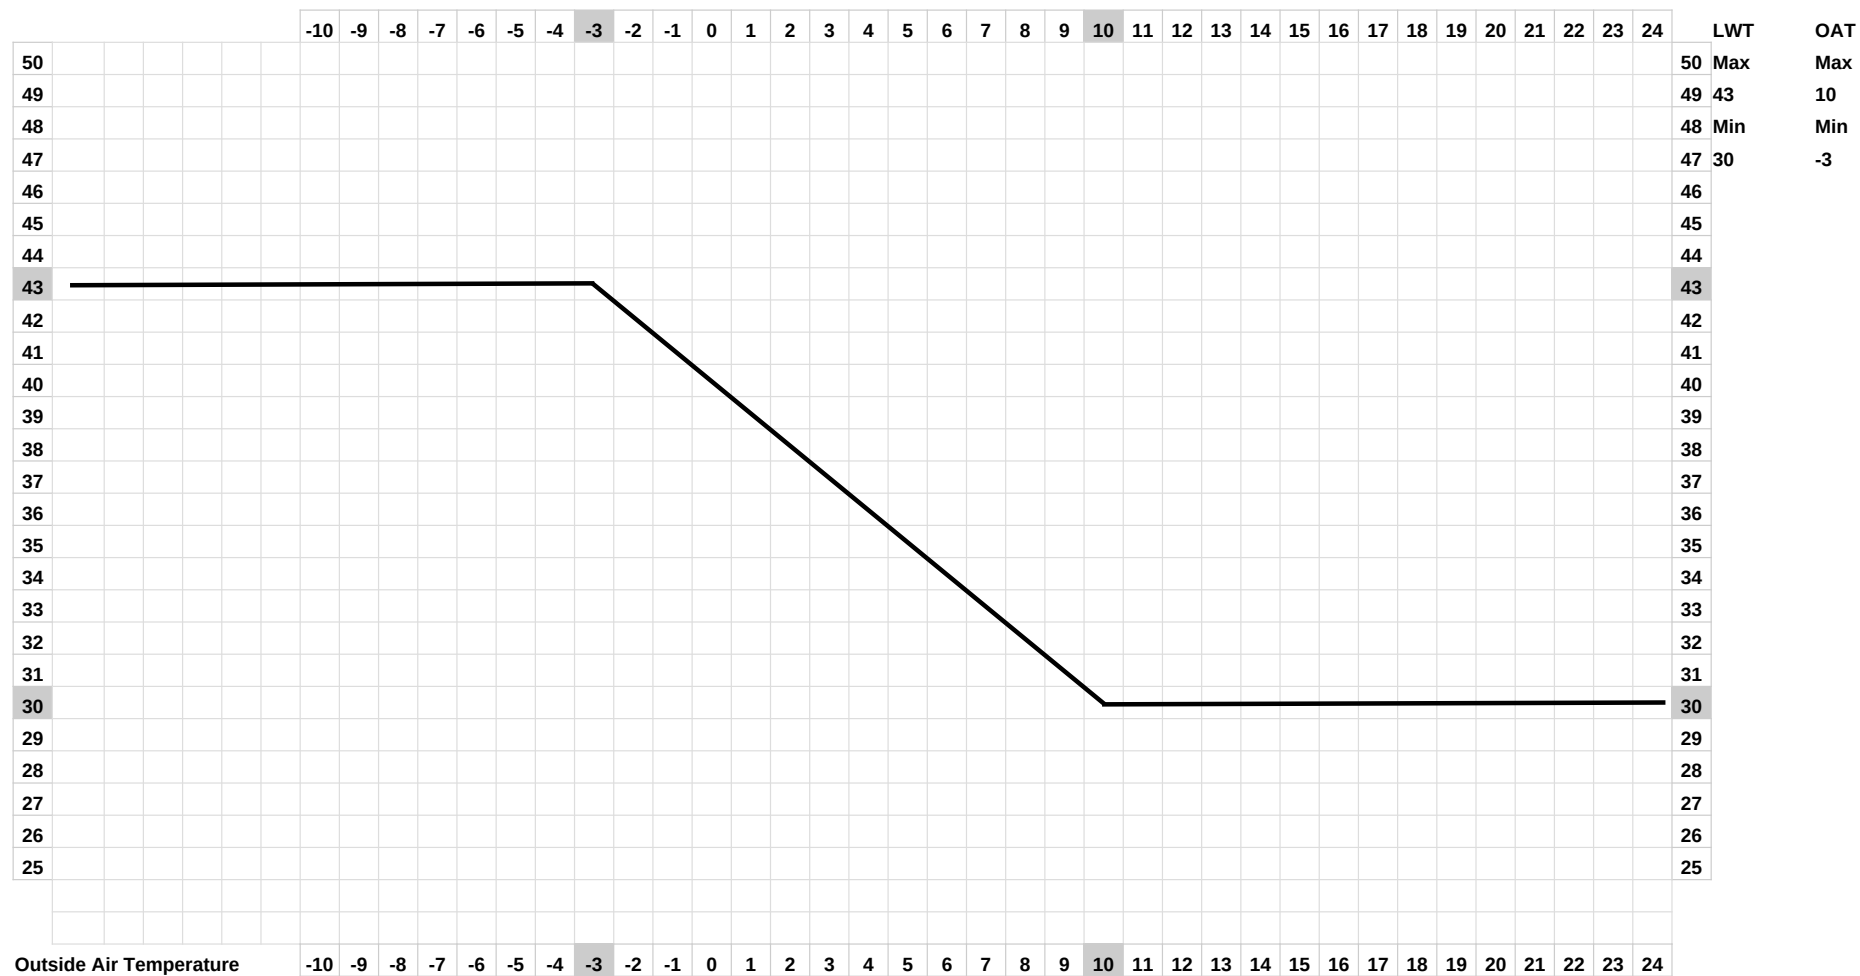

Reason for change: Changed from Octopus settings as I felt 50C was too hot, uses more energy and could have damaged flooring in extension due to possible temp

Results: